


- General Notes:
1. MOUNT FUSED DISCONNECT SWITCH AND TVSS TO SIDE OF SWITCHGEAR AT BOTH ENDS. CONNECT LEADS DIRECTLY TO BUS.
  2. INSTALL UTILITY APPROVED METER CABINET AT LOCATION SHOWN ON PLANS.
  3. INSTALL CONDUIT FOR PRIMARY SERVICE WITH SPARE FROM HIGH VOLTAGE THROUGH THE METER CABINET TO LOCATION OF UTILITY OWNED MOUNTED SWITCHGEAR SHOWN ON SITE PLAN.
  4. FEEDER FROM UTILITY OWNED TRANSFORMER DOES NOT INCLUDE GROUND CONDUCTORS.

FOR FUTURE ELECTRIC SERVICE AND GENERATOR

NOTE 2

NOTE 3

NOTE 4

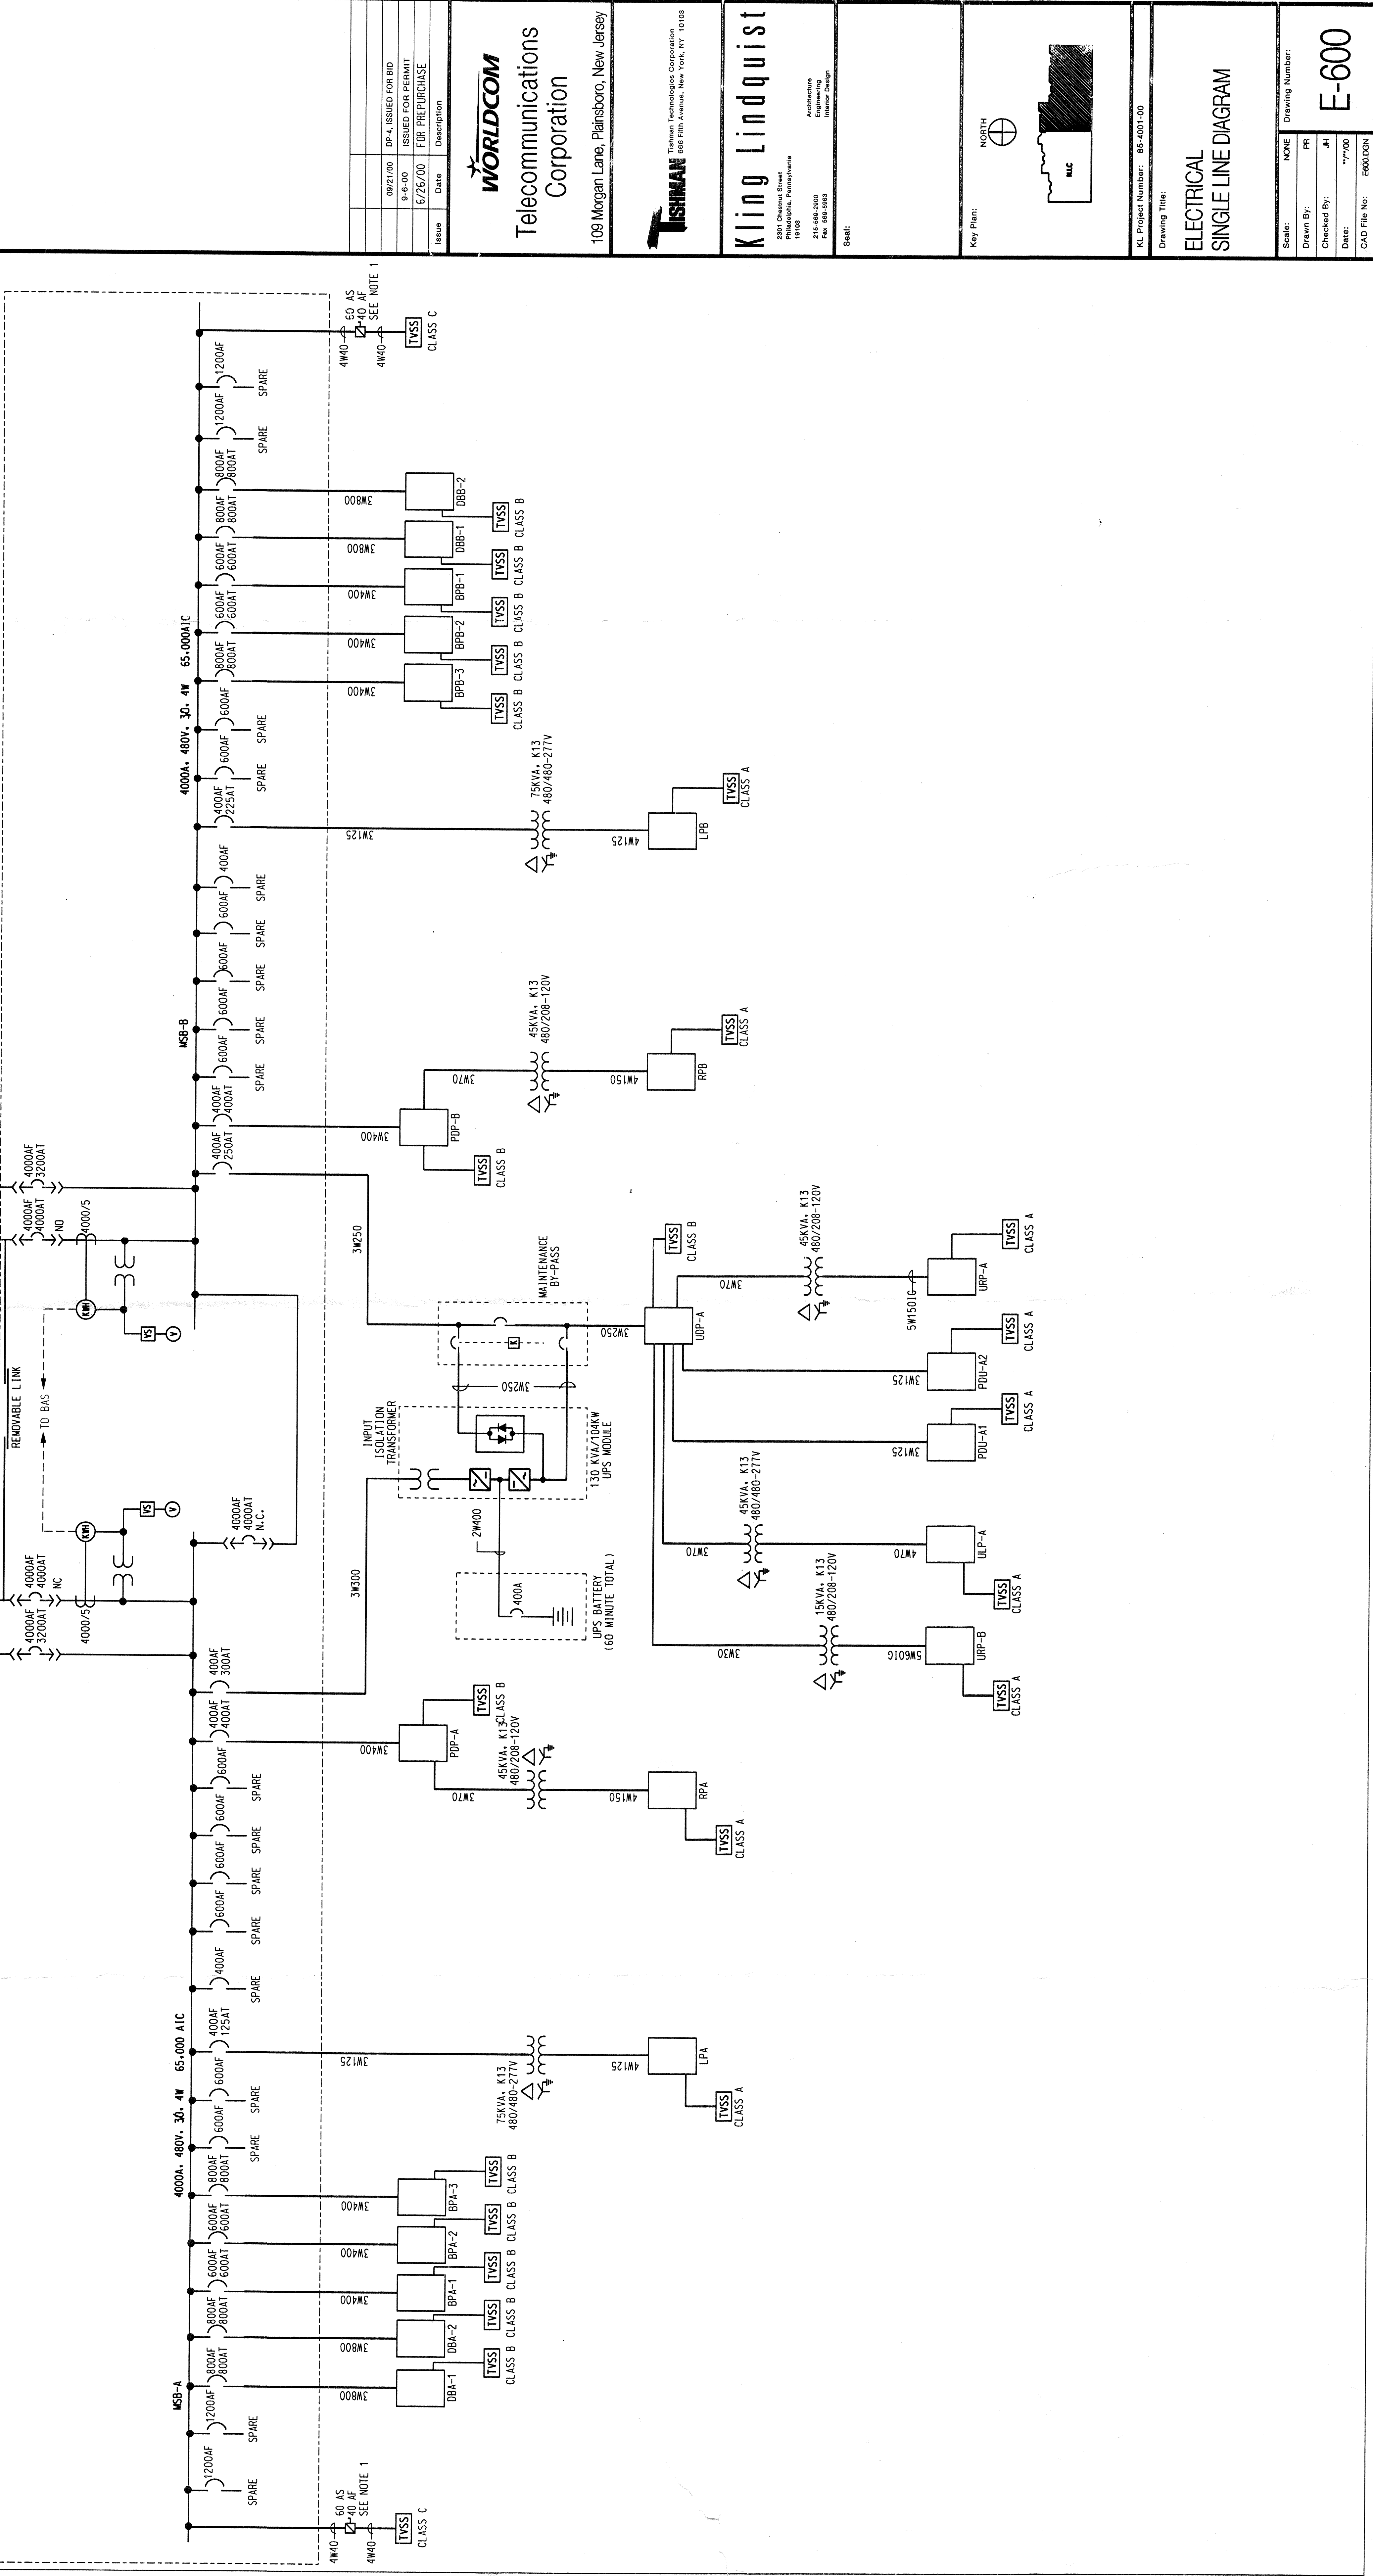

Issue	Date	Description
08/21/00	08/21/00	DP-4, ISSUED FOR BID
9-16-00	9-16-00	ISSUED FOR PERMIT
5/26/00	5/26/00	FOR PREPURCHASE

**WORLD COM**  
Telecommunications Corporation

109 Morgan Lane, Plainsboro, New Jersey

**TISHMAN**  
Tishman Technologies Corporation  
808 Fifth Avenue, New York, NY 10108

**Kling Lindquist**  
280 Chestnut Street  
Philadelphia, Pennsylvania 19106  
215-462-2900  
Fax: 215-462-8893

Scale: NONE  
Drawing Number: 85-4001-00  
Drawing Title: ELECTRICAL SINGLE LINE DIAGRAM

Key Plan: NORTH  
AUC

Scale	None	Drawing Number	85-4001-00
Drawn By:	PR	Checked By:	JH
Date:	7/7/00	CAD File No:	89010204

E-600