


General Notes:

1. INSTALL OUTDOOR METERING TRANSFORMER CABINET IN ACCORDANCE WITH PSE&G REQUIREMENTS. INSTALL FOR BOTH INITIAL AND FUTURE SERVICE. INSTALL METERING TRANSFORMERS PROVIDED BY PSE&G.
2. FURNISH AND INSTALL PSE&G APPROVED WEATHERPROOF ENCLOSURE TO METER CABINET SIDE. INSTALL APPROVED METER SOCKET INSIDE ENCLOSURE.

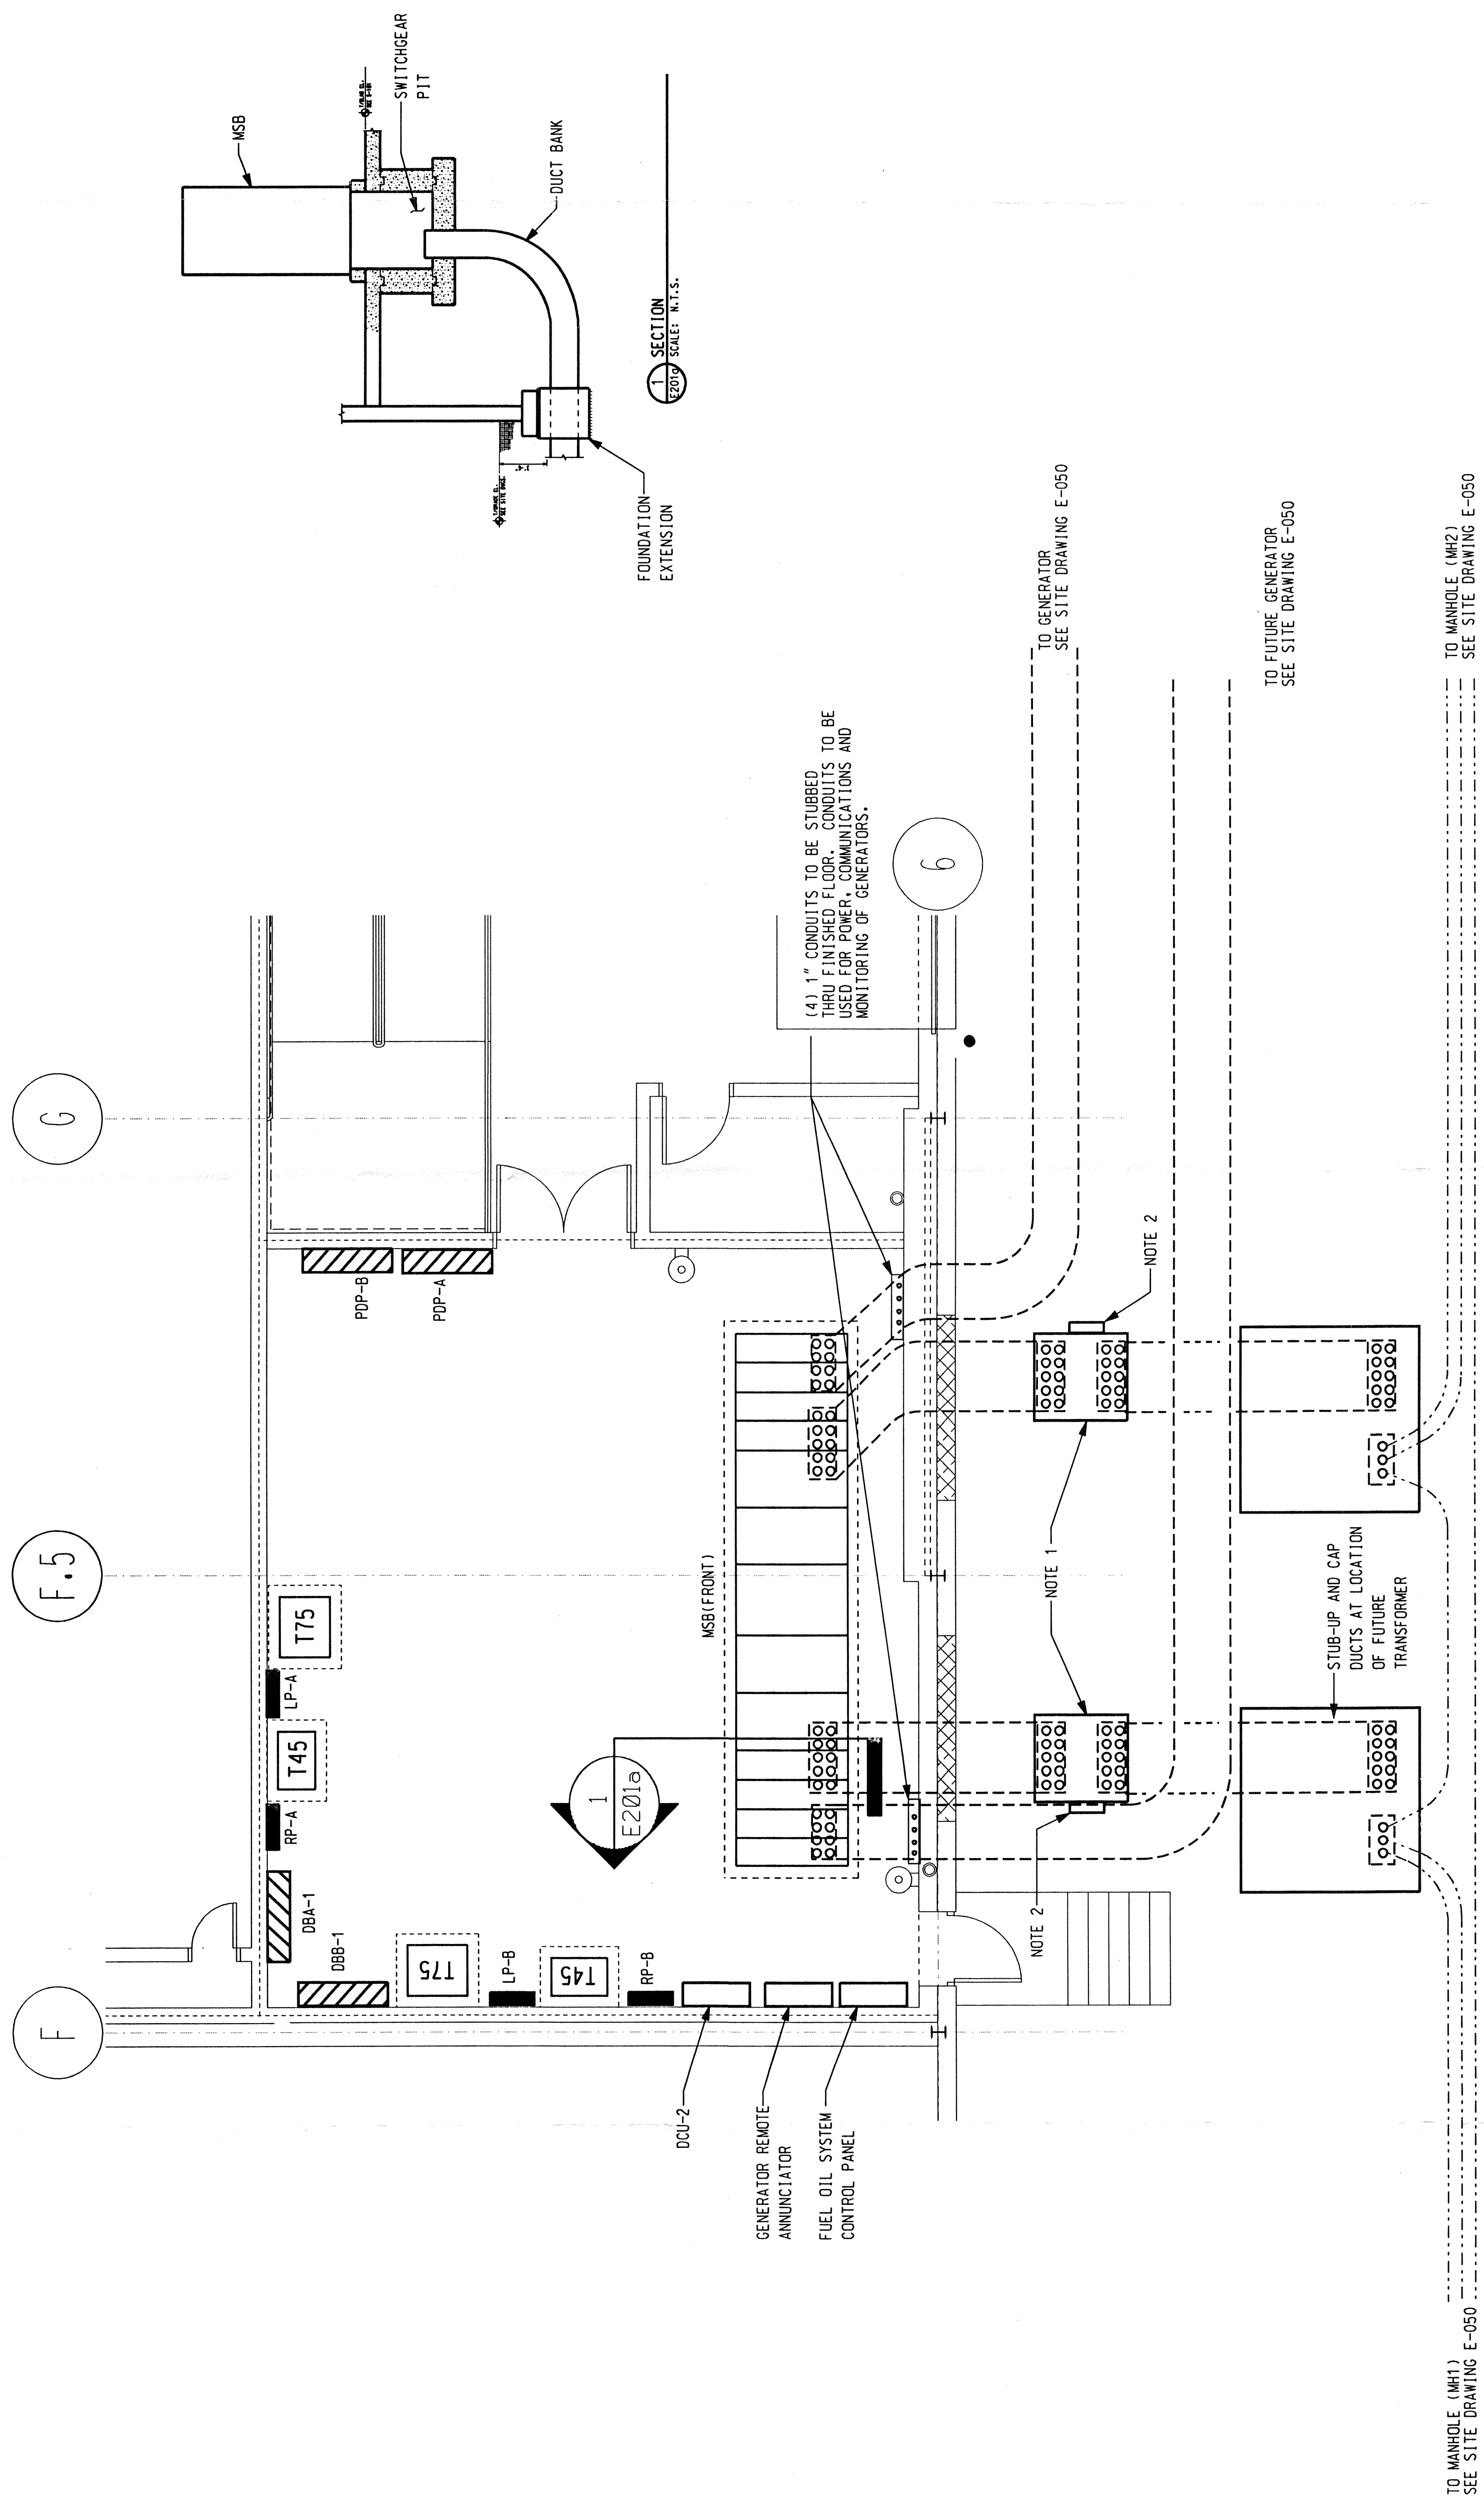

Issue	Date	Description
09/21/00	DP-4	ISSUED FOR BID

WORLD COM
Telecommunications Corporation
109 Morgan Lane, Plainsboro, New Jersey

TISHMAN
Tishman Telecommunications Corporation
280 Chestnut Street
Philadelphia, Pennsylvania
Tel: 484-5955
Fax: 484-5953

Kling Lindquist
280 Chestnut Street
Philadelphia, Pennsylvania
Tel: 484-5955
Fax: 484-5953

Scale: 1/4"=1'-0"
Drawing Number: KL Project Number: 85-4001-00

Key Plan:
NORTH
MCI

Drawing Title:
**MCI WORLD COM
ENLARGED ELECTRICAL
ROOM PLAN**

Scale: 1/4"=1'-0"
Drawing Number:
Drawn By: FR
Checked By: JH
Date: 06/20/00
CAD File No: E201A.DGN
E-201A